


BEST PRACTICES FOR DRY VALVE AND PRE-ACTION SYSTEMS

LEGEND

- A. AIR COMPRESSOR WITH TANK
- B. RISER MOUNT AIR COMPRESSOR WITH DIGITAL AIR MAINTENANCE DEVICE
- C. AIR COMPRESSOR ON BASEPLATE
- D. AIR MAINTENANCE DEVICE (CAMD1)
- E. DRY/PRE-ACTION VALVE


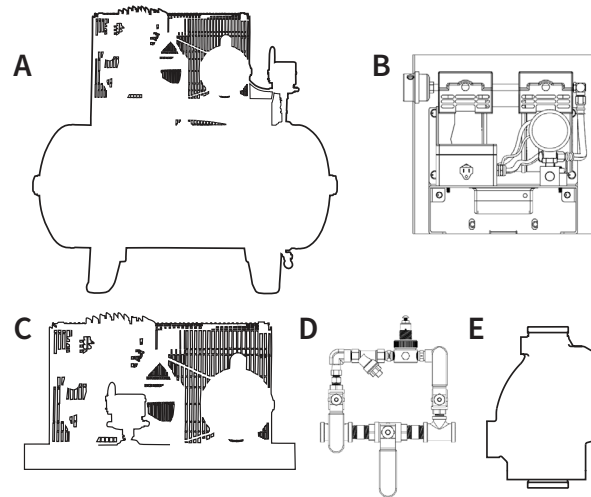


SIZE LIMITATIONS: AIR COMPRESSORS WITH FLOW GREATER THAN 5.5 CFM AT 10 PSI REQUIRE A TANK AND REGULATOR STYLE AIR MAINTENANCE DEVICE WITH A BYPASS AND RESTRICTOR. (NFPA 13 8.2.6.6)*

*Reproduced with permission from NFPA 13-2022, Installation of Sprinkler Systems, Copyright © 2022, National Fire Protection Association, Quincy, MA. This reprinted material is not the complete and official position of the NFPA on the referenced subject, which is represented only by the standard in its entirety which may be obtained through the NFPA website at www.nfpa.org.

C-AIRE[®]
 COMPRESSORS
 380 W 1ST ST, DRESSER, WI 54009
 651-462-3440
CAIRECOMPRESSORS.COM

SINGLE VALVE SYSTEMS

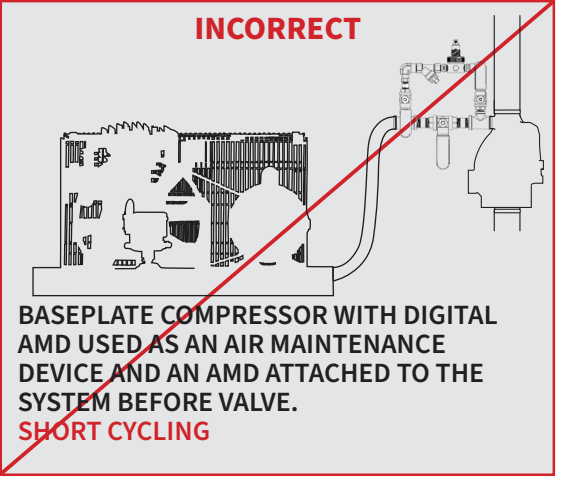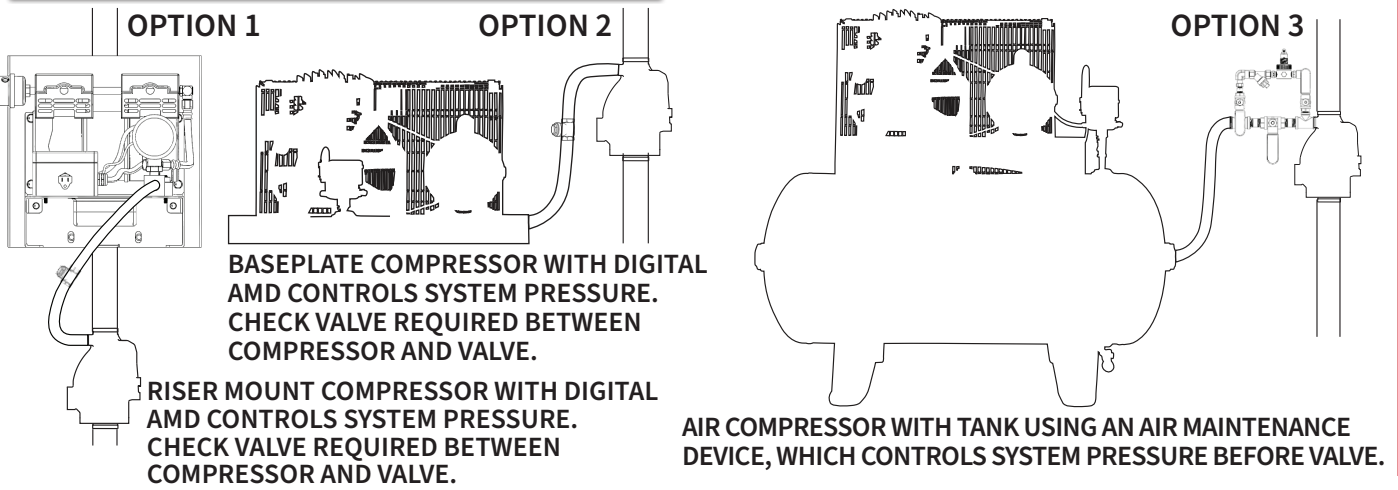

MULTIPLE VALVE SYSTEMS

